


NCP T15

Smoke-Rated Astragal Seal Set



SEAL

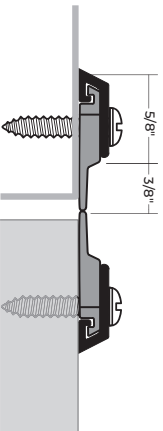

BHMA
CERTIFIED



POSITIVE PRESSURE TESTED GASKETING MATERIALS
FOR FIRE DOORS FOR APPLICATION TO HOLLOW-
METAL-TYPE FIRE DOORS RATED UP TO 3 HOURS
AND WOOD-TYPE FIRE DOORS RATED UP TO 1½
HOURS, CATEGORY H

SMOKE AND DRAFT CONTROL GASKETING
(CATEGORY H) TESTED TO UL 1784;
MEETS REQUIREMENTS OF NFPA 105,
IBC FOR USE ON "S" LABEL DOORS.

- Aluminum Alloy 6063, T5 Temper
- Flame/Moisture Resistant
- #6 X ¾" Stainless Steel Sheet Metal Screws Furnished


ngp.com

1-800-NCP-RUSH

See ngp.com for All Applicable
Certifications for this Product.

INSTALLATION INSTRUCTIONS

115

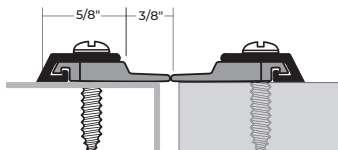

1. Cut astragal to length.
2. Position on doors as shown above.
3. Mark screw holes.
4. Drill pilot holes for screws using a $\frac{7}{64}$ " drill bit.
5. Install with screws provided.
6. Adjust astragal so it does not impede proper closing and latching of doors.



ngp.com

1-800-NGP-RUSH

FAX: (800) 255-7874

QUOTES: quotes@ngp.com

ORDERS: orders@ngp.com

MEMPHIS

4985 East Raines Road
Memphis, TN 38118

CARSON CITY

3689 Arrowhead Drive
Carson City, NV 89706