



# GAP90N™

Gap Solution for Excessive Fire Door and Frame Clearances  
90 Minutes Up to 3/8" or 45 Minutes up to 9/16"

## INSTALLATION INSTRUCTION

For the complete list of GapGuard™ Fire Door Accessories, the most up-to-date product information and installation instructions, scan the QR code or visit [ngp.com](http://ngp.com).




### Requires installation of ALL components below:

- ▶ UL Certified Solution for Fire Doors with Excessive Clearance Between Door and Frame Over 1/8" and up to 3/8" for 90 Minutes or Over 1/8" and up to 9/16" for 45 Minutes
- ▶ Patented:  
US Patent 9,273,510 B2

### 9945N – 16 Gauge Steel Stop Extender:

1. Cut to fit.
  - a. Doors with Parallel Arm Closers and Surface Vertical Rod or Rim Exit Devices; Cut 9945N Steel Stop Extender and omit at closer shoe or exit device strike.
2. Position on frame stop soffit as illustrated.
3. Install with TEK Screws provided in all mounting holes, working from one end to the other.

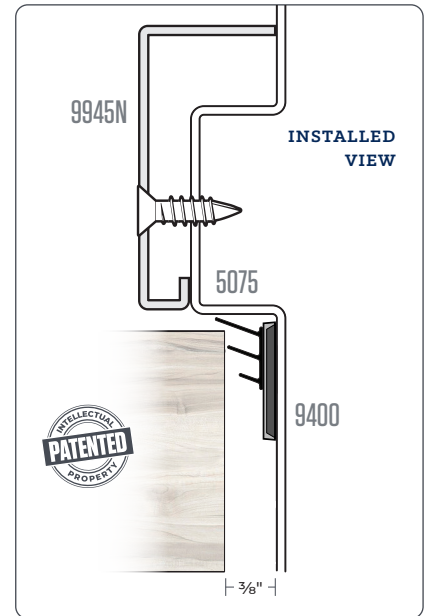


### Next install 9400 Intumescent followed by 5075 in the location shown as follows:

### 9400 – Self-Adhesive Intumescent Seal and 5075 – Self-Adhesive Smoke Seal:

1. The surface temperature of the frame must be above 60°F for adhesive to bond.
2. Clean frame or door with clean wipe provided remove dust, oil, grease and dirt. Wax coated or high gloss painted surfaces may require roughening with a Scotch-Brite™ pad or sandpaper so adhesive will bond properly.

3. Measure and pre-cut pieces to fit where seal is to be mounted. Cut around and do not obstruct any fire label on frame.
4. Remove protective backing 1 to 2 feet at a time.
5. Position on frame where illustrated along entire length of excessive clearance. Omit material for strike, fire label, latchbolt of lock or exit device. As the 9400 intumescent seal is installed on rabbet, the 5075 smoke seal may also be installed on rabbet and/or stop face.

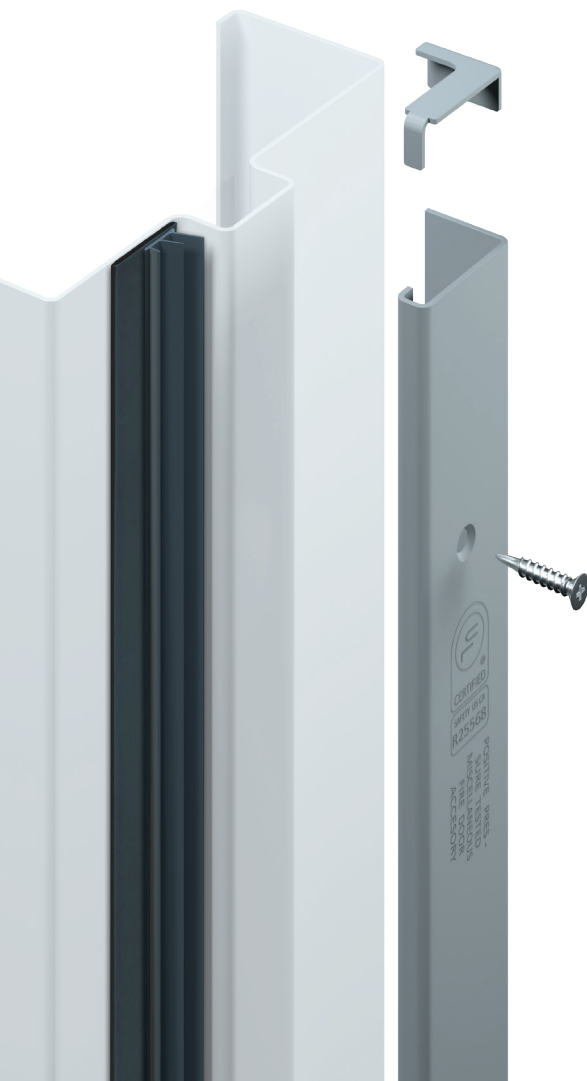

# GAP90N™ INSTALLATION INSTRUCTIONS (CONTINUED)

6. Adhere by pressing firmly (approx. 15 lbs. pressure required) straight down along entire length of gasketing. Do not remove and relocate.
7. Make sure the seal does not impede proper closing and latching of the door.

For use on up to 90-minute UL10B, UL10C and CAN/ULC-S104 wood or hollow metal fire doors with head and or jamb clearance exceeding  $\frac{1}{8}$ ", up to  $\frac{3}{8}$ ".

For use on up to 45-minute UL10B, UL10C and CAN/ULC-S104 wood or hollow metal fire doors with head and or jamb clearance exceeding  $\frac{1}{8}$ ", up to  $\frac{1}{4}$ ".

An NGP strike shim 9275 or 9225 may be required for proper latchbolt engagement.

Hinge edge of category B wood doors requires a UL certified category G edge seal.

5075 is Smoke & Draft Control Gasketing (Category H) tested to UL 1784; meets requirements of NFPA 105, IBC for use on 'S' label doors.



POSITIVE PRESSURE TESTED  
MISCELLANEOUS FIRE DOOR  
ACCESSORY

01.25

## STORAGE AND SHELF LIFE

The adhesive on this seal has a shelf life of one year stored at 75°F and 50% relative humidity or less

**Made in USA**

NGP-GAP-GAP90N-PRI-0125-A



MEMPHIS | CARSON CITY

## NATIONAL GUARD PRODUCTS, INC.

### MEMPHIS

4985 East Raines Road  
Memphis, TN 38118

### CARSON CITY

3689 Arrowhead Drive  
Carson City, NV 89706

**Fax:** (800) 255-7874

**Email:** [info@ngp.com](mailto:info@ngp.com)

**Quotes:** [quotes@ngp.com](mailto:quotes@ngp.com)

**Orders:** [orders@ngp.com](mailto:orders@ngp.com)

**ngp.com**  
**1-800-NGP-RUSH**