

L-GLF100

For 1-3/4" Door with 3/16", 1/4" and 5/16" Glass

Installation Instructions


1. Cut out door in accordance with door manufacturers listing procedure. Steel fire-rated doors do NOT require an opening reinforcing channel or reinforcing clips.
2. Install glass & glazing material (sold separately), into lite kit.
3. Position outer frame in door cut out.
4. Position inner frame and insert and start all screws before fully tightening.
5. Tighten screws using a criss cross pattern. Use caution when using power screw driving equipment to avoid stripping the material.

For Fire Rated Doors, using 1/4" fire rated wire glass:
 20 & 45 minute = 1,296 sq. inches max visible glass, 54" max height, 54" max width.
 60 & 90 minute = 100 sq. inches max visible glass, 33", max height, 10" max width.
 Sizes exceeding those shown above may be achieved using Pyran® Platinum F, Pyran® Platinum L, Protect3™ or 20T™.
 Maximum size is determined by the glass listing (in doors) and door manufacturers listing.

UL10-C Positive Pressure rated fire doors using 1/4" wired glass: 20 min. requires closed cell PVC foam glazing tape like NGP L-GT-114, L-GT-116, L-GT-118, L-GT-132 or L-GT-316. 45, 60, 90 min requires NGP 9800C or 3M GIS intumescent glazing tape.

UL10C Positive Pressure rated fire doors using Pyran® Platinum F, Pyran® Platinum L, Protect3™ or 20T™ requires closed cell PVC foam glazing tape like NGP L-GT-114, L-GT-116, L-GT-118, L-GT-132 or L-GT-316.

FIELD PAINTING: for best results scuff finish with a Scotch-brite pad or sand paper before painting.

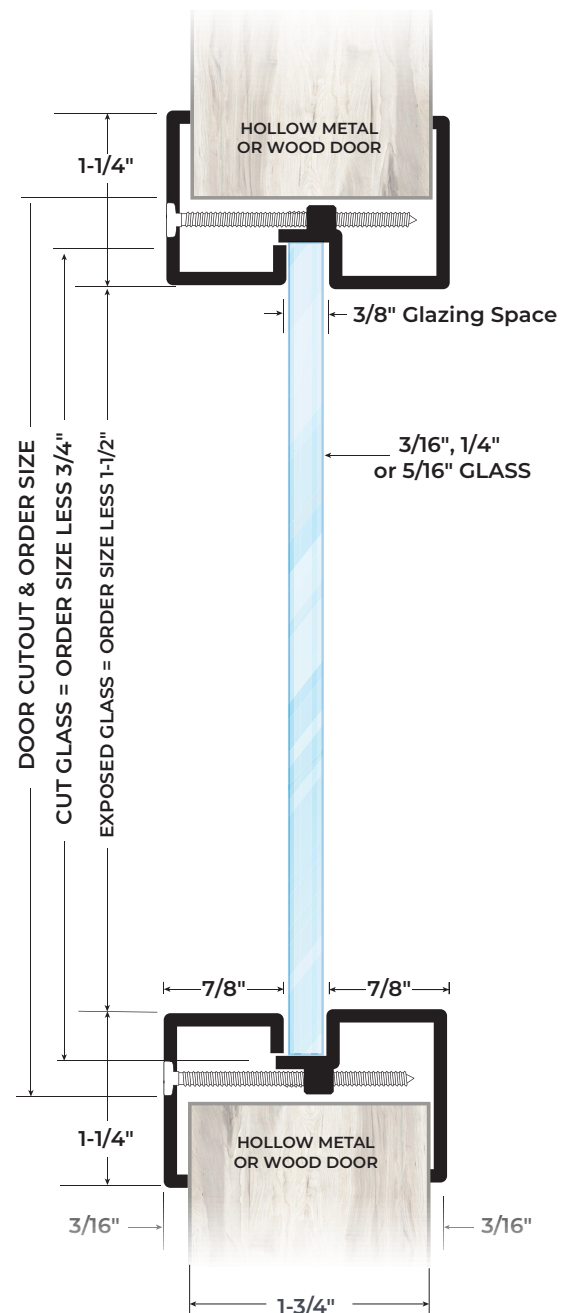

Fire Door Glass
Light Frame